




# PDF Export

01/09/19 13:44:00 - 06/09/19 16:49:00

Date created 01/10/19 12:11:39

Created by Account Owner

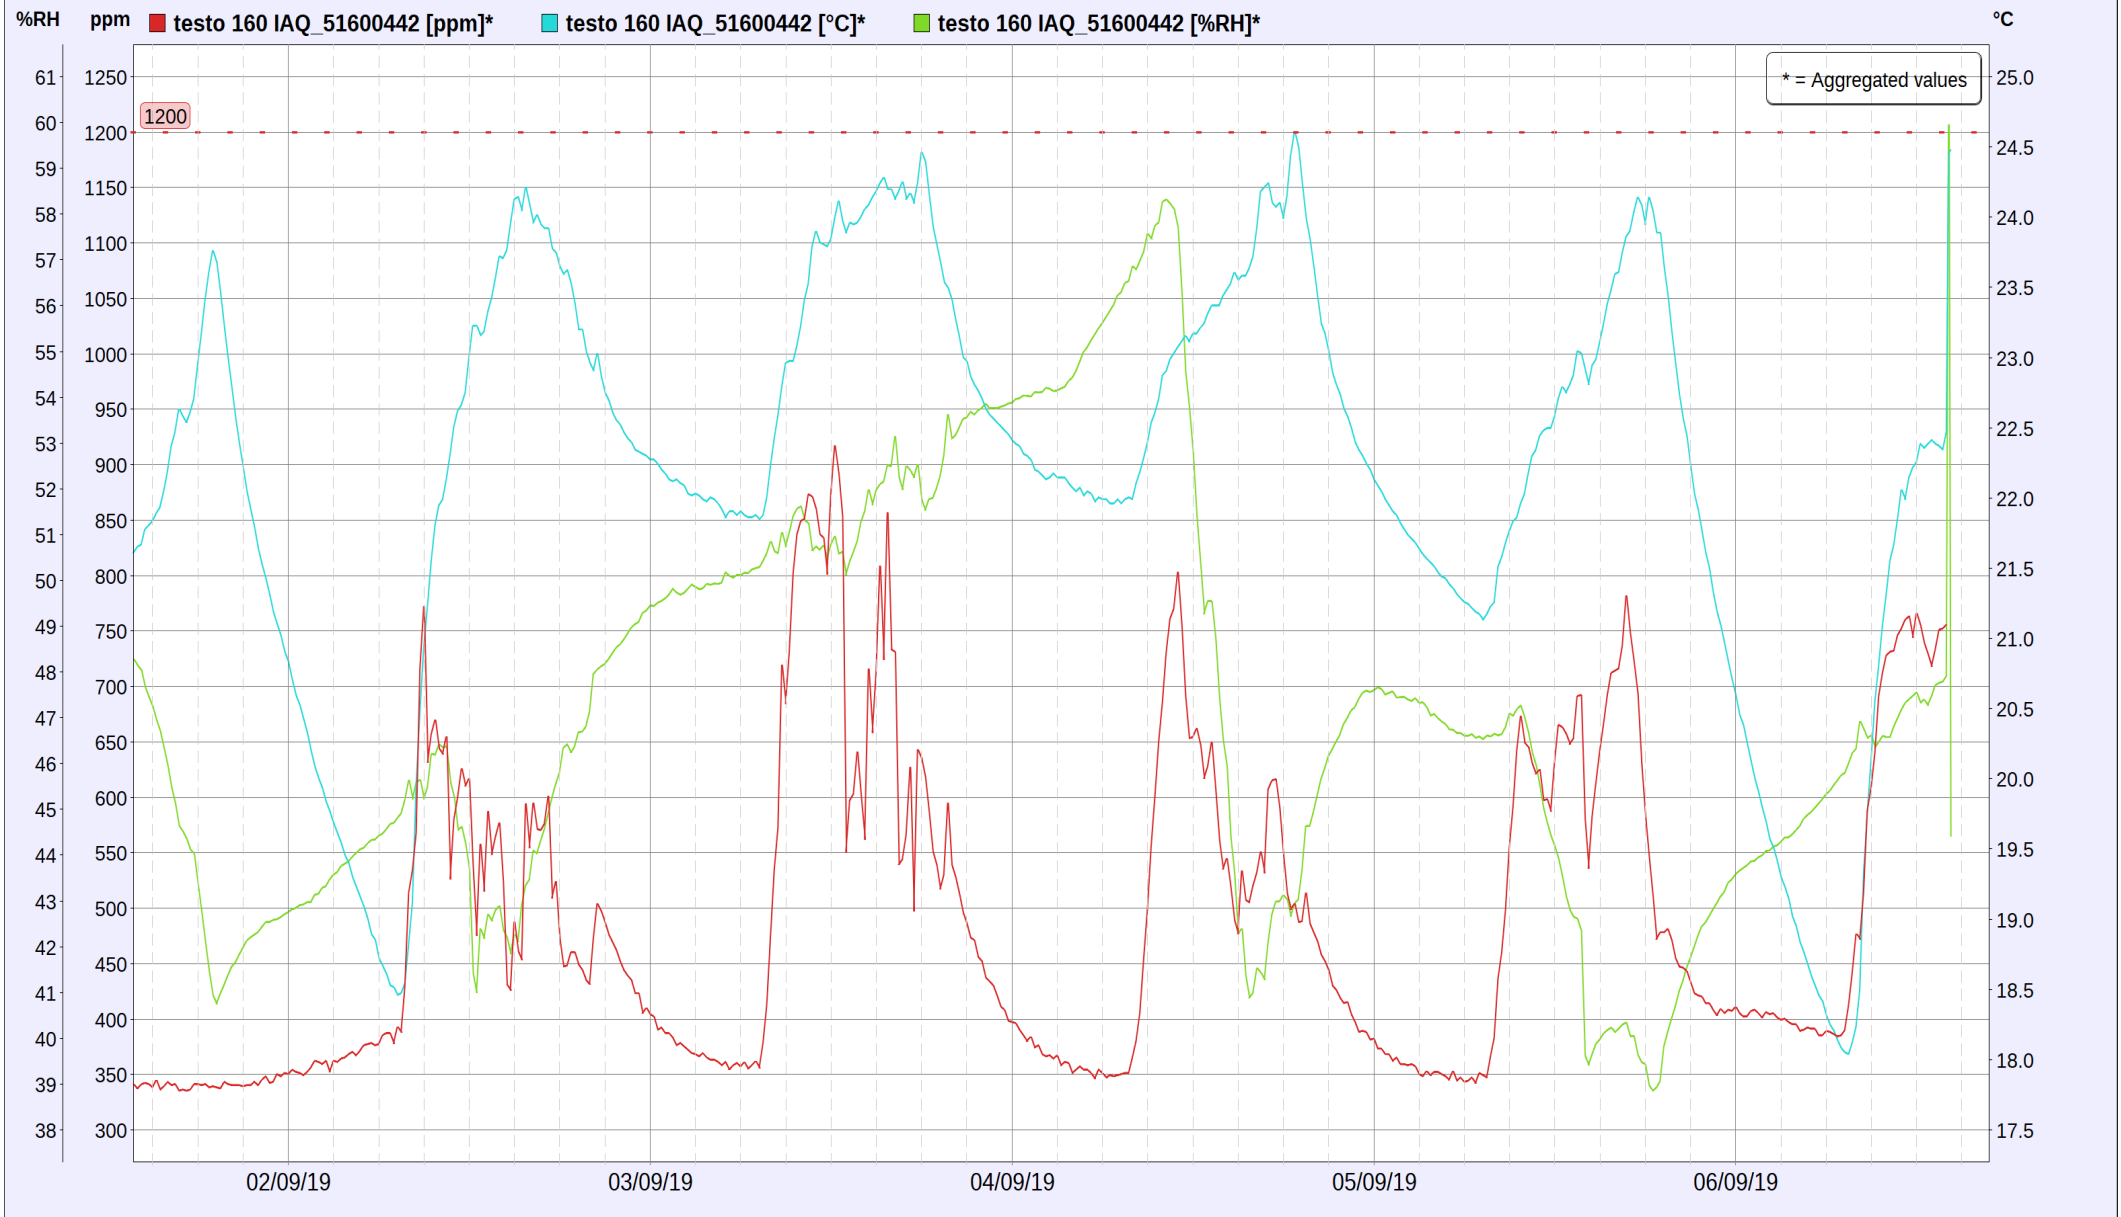




# PDF Export

01/09/19 13:44:00 - 06/09/19 16:49:00

Date created 01/10/19 12:11:39

Created by Account Owner

## Alarm list

Status	Date	Type	Location / Measuring point group / Area	Action
	06/09/19 15:46:25	Alarm	testo 160 IAQ_51600442	Overshooting (1621ppm > 1100ppm)