



NF EN 60903 : 2003  
CEI 60903 : 2002

(\*) Add the size :  
A = size 8, B = size 9,  
C = size 10, D = size 11

## FIELD OF USE

Personal protection against electrical shocks for live working from 500 to 36 000V.

These gloves have to be used with leather overgloves, to ensure a mechanical protection.

The use of thin cotton undergloves is recommended for a better comfort and a good hygiene.

## CARACTERISTICS

- Temperature of use : -25°C to +55°C
- In conformity with the IEC 60903 : 2002 , EN 60903 : 2003
- Insulating gloves from class 00 (500V) to class 4 (36 000V)
- Material : natural latex
- AZC or RC Category : resistant to acid, ozone and extremely low temperature or acid, oil, ozone and extremely low temperature
- Colour : beige This packaging pro
- This shape will ensure good ergonomics and a good sensitivity.
- Gloves marking following IEC 60903
- With an Instruction for use
- Delivered in individual packaging, which is in different colours following the gloves class. This packaging provide a UV protection


RANGE Reference	Class	Category	Packaging	Voltage max		Weigth (g)
				AC	DC	
CG-05-*	00	AZC	beige	500	750	90
CG-10-*	0	RC	Red	1 000	1 500	200
CG-15-*	1	RC	White	7 500	11 250	270
CG-20-*	2	RC	Yellow	17 000	25 500	450
CG-30-**	3	RC	Green	26 500	39 750	560
CG-40-***	4	RC	Orange	36 000	54 000	800


(\*) Add the size : A = Size 8, B = Size 9, C = Size 10, D = Size 11

(\*\*) Add the size : B = Size 9, C = Size 10, D = Size 11

(\*\*\*) Add the size : C = Size 10, D = Size 11

### MARQUAGE

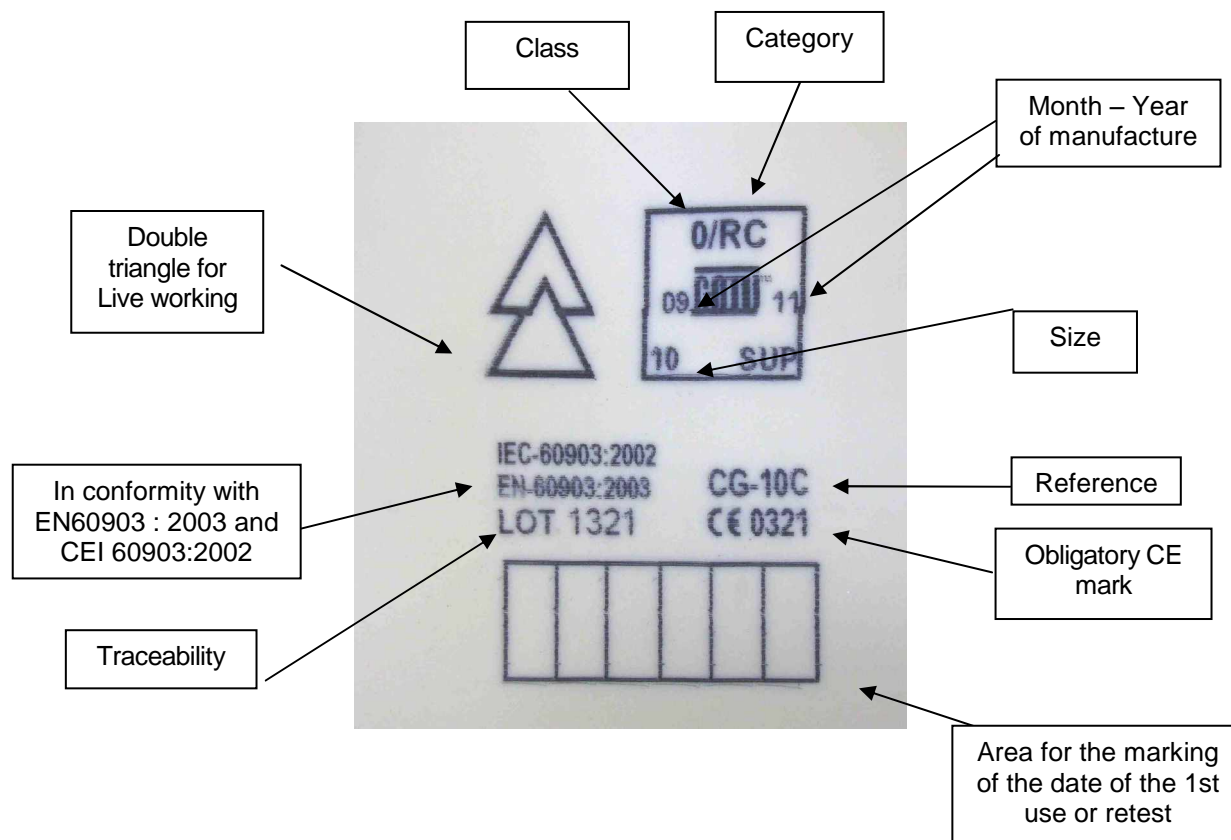

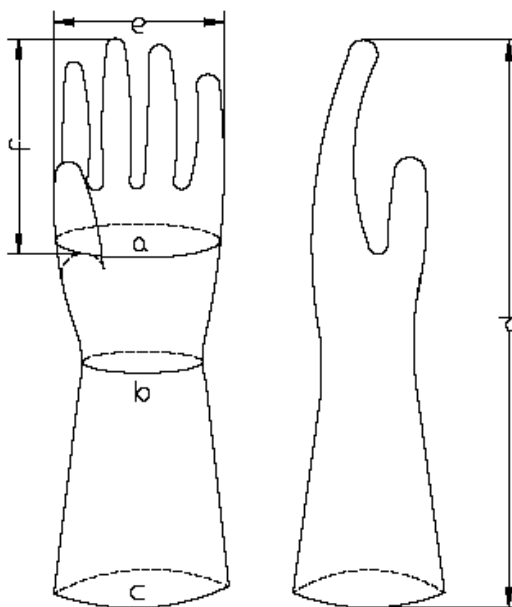

### DIMENSIONS (mm)

Reference	Size	a	b	c	d	e	f	Thickness max
CG-05-A	8	210	220	330	360	95	110	1.10
CG-05-B	9	235	230	340	360	100	110	1.10
CG-05-C	10	255	240	350	360	110	115	1.10
CG-05-D	11	280	255	360	360	125	120	1.10
CG-10-A	8	210	220	330	360	95	110	1.60
CG-10-B	9	235	230	340	360	100	110	1.60
CG-10-C	10	255	240	350	360	110	115	1.60
CG-10-D	11	280	255	360	360	125	120	1.60
CG-15-A	8	210	220	330	360	95	110	2.10
CG-15-B	9	235	230	340	360	100	110	2.10
CG-15-C	10	255	240	350	360	110	115	2.10
CG-15-D	11	280	255	360	360	125	120	2.10
CG-20-A	8	210	220	330	360	95	110	2.90
CG-20-B	9	235	230	340	360	100	110	2.90
CG-20-C	10	255	240	350	360	110	115	2.90
CG-20-D	11	280	255	360	360	125	120	2.90
CG-30-A	8	210	220	330	360	95	110	3.50
CG-30-B	9	235	230	340	360	100	110	3.50
CG-30-C	10	255	240	350	360	110	115	3.50
CG-30-D	11	280	255	360	360	125	120	3.50
CG-40-C	10	255	245	350	410	110	115	4.20
CG-40-D	11	280	255	360	410	125	120	4.20

**RECOMMANDATIONS (annex E CEI 60903)**

- **Examination before use:** Each time before use, both gloves of a pair should be visually inspected and subjected to a manually applied air test, where practicable. If either glove is thought to be unsafe, the pair should not be used and should be returned for testing.
- **Storage:** Gloves should be stored in their container or package. Care should be taken to ensure that gloves are not compressed, folded or stored in proximity to steam pipes, radiators or other sources of artificial heat or exposed to direct sunlight, artificial light or other source of ozone. It is desirable that the ambient temperature be between 10°C and 21°C.
- **Periodic inspection:** For class 00 and O gloves, a check for air leaks and a visual inspection may be consider adequate. However a routine dielectric test may be performed at the owner's request
- **Class 1, 2, 3 et 4 :** no gloves, not even those held in storage, should be used unless they have been tested within a maximum period of six months. The tests consist of air inflation to check for air leaks, a visual inspection while pressurized, and then a routine dielectric test, in accordance with IEC60903.
- **The date of the 1<sup>st</sup> use, and the controls dates, have to be marked in the area on the gloves.**

**ACCESSORIES (Option)**

Cotton under-gloves CG-80



Cotton mittens CG-81



Gloves box CG-35/2



Over-gloves CG-98



Pneumatic gloves tester CG-117